## NOTES TO APPLICANT:

Maximum height at which meters can be fitted is 1700mm from top of meter to finished floor level when using the top chamber, and 1000mm to finished floor level when using the bottom chamber. (This is to ensure maximum length of meters tails is not exceeded).

Minimum height at which meters can be fitted is 300mm from bottom of meter to finished floor level

Minimum size of trunking is 150mm x 150mm except above and below the multi-way board where a minimum size of 225mm x 225mm required.

Customer intake equipment shown is indicative only and should be designed by the applicant to meet their specific requirements.

Maximum number of useable ways is 18 no. For a communal meter position arrangment, a maximum of 7 no. single-phase meters can be supplied via tails, plus a three phase landlords supply using the bottom cable chamber entry shown. For the remaining 8 no. services and meters the top entry cable chamber must be used.

It is a condition of our service quotation for multi-way intakes that the electrical contractor submits a scaled sketch of the proposed equipment layout for our approval prior to acceptance of quotation.

All trunking and meter tails must be provided and installed by the Applicant. Meter tails terminated to JE plant by JE personnel only.

Max length of meter tails not to exceed 3m. Meter Tails are not to transit between floors.


For all meter dimensions, Refer to JE drawing 80-N21.

Supply position must be secure and environmentally safe. JE equipment shall only be fixed onto a visible 18mm fire rated (B-S1-D0 or ASTM E84 class A certification) or equivilent. The applicant's contractor shall ensure the backboard is adequitely fixed to any substrate layers, but not to the detriment of the enclosures fire rating.

No other equipment may be installed over the top of any JE cables or equipment.

JE will not install into any cupboard that has water services, plumbing, drainage, or raw water pipes within it.

Fireproofing of the cable slots between floors should be carried out with adequately rated removable fire bags provided and installed by the applicant.

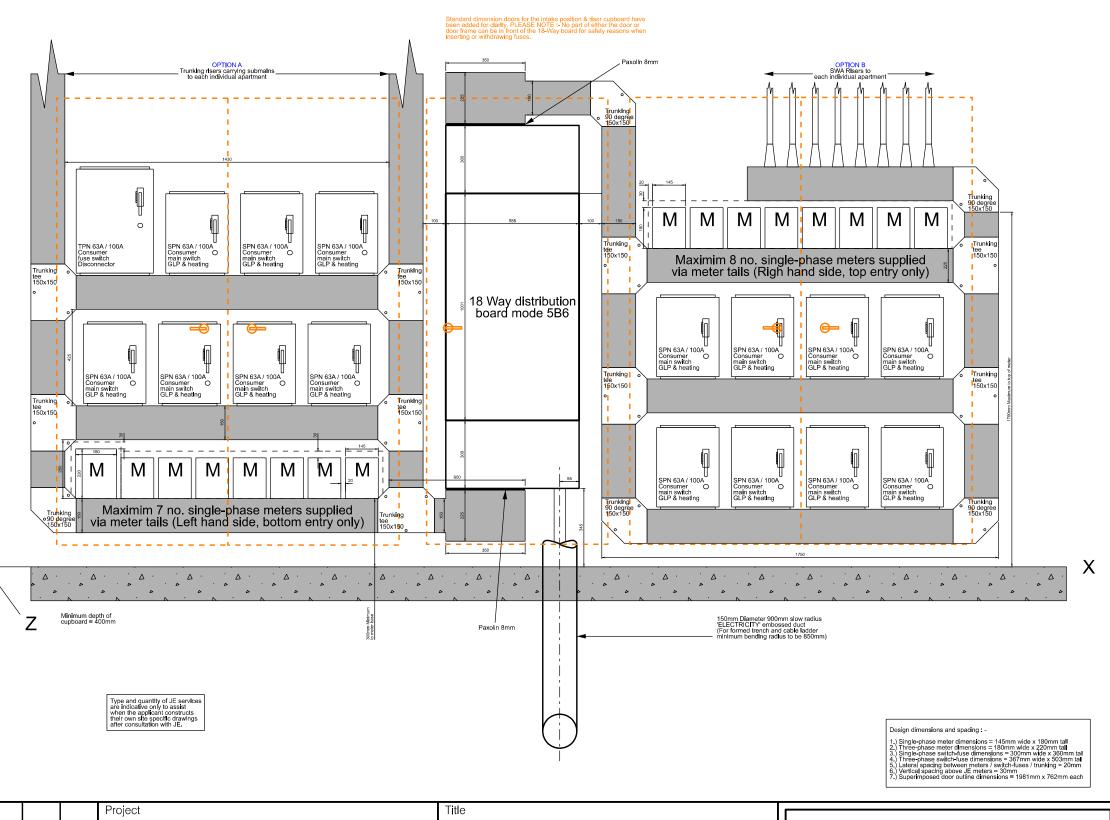

					F
С	03-12-2024	Backboard note amended	AB	ML	
В	01-02-2024	Notes updated and minor mods	TSB	ML	
Α	01-11-2023	Minor updates	AB	ML	
-	23-08-23	Original Issue	TSB	ML	
Rev	Date	Description	Drn	Appd	

General Arrangement Drawing 18-Way Distribution Board 5B6 without LV rising
Main showing the maximum quantity of
communally metered Single-Phase services from
both top & bottom cable chambers, & also
including a Three-Phase Landlord service from

the bottom cable chamber.

remain strictly the property of 'Jersey Electricity Company plc' and may not be copied

and /or reproduced in any form without their 'Express Permission'

The Intellectual Property Rights (IPR) ie. Patents, Copyright, Trade Secrets, Design Rights etc.,



737-N21

Revisio